


# MICRO-FAST 4.5 5000 Tank 54" LL 61" INLET

Install a 1,600 Gallon  
Trash Tank Upstream From This Tank

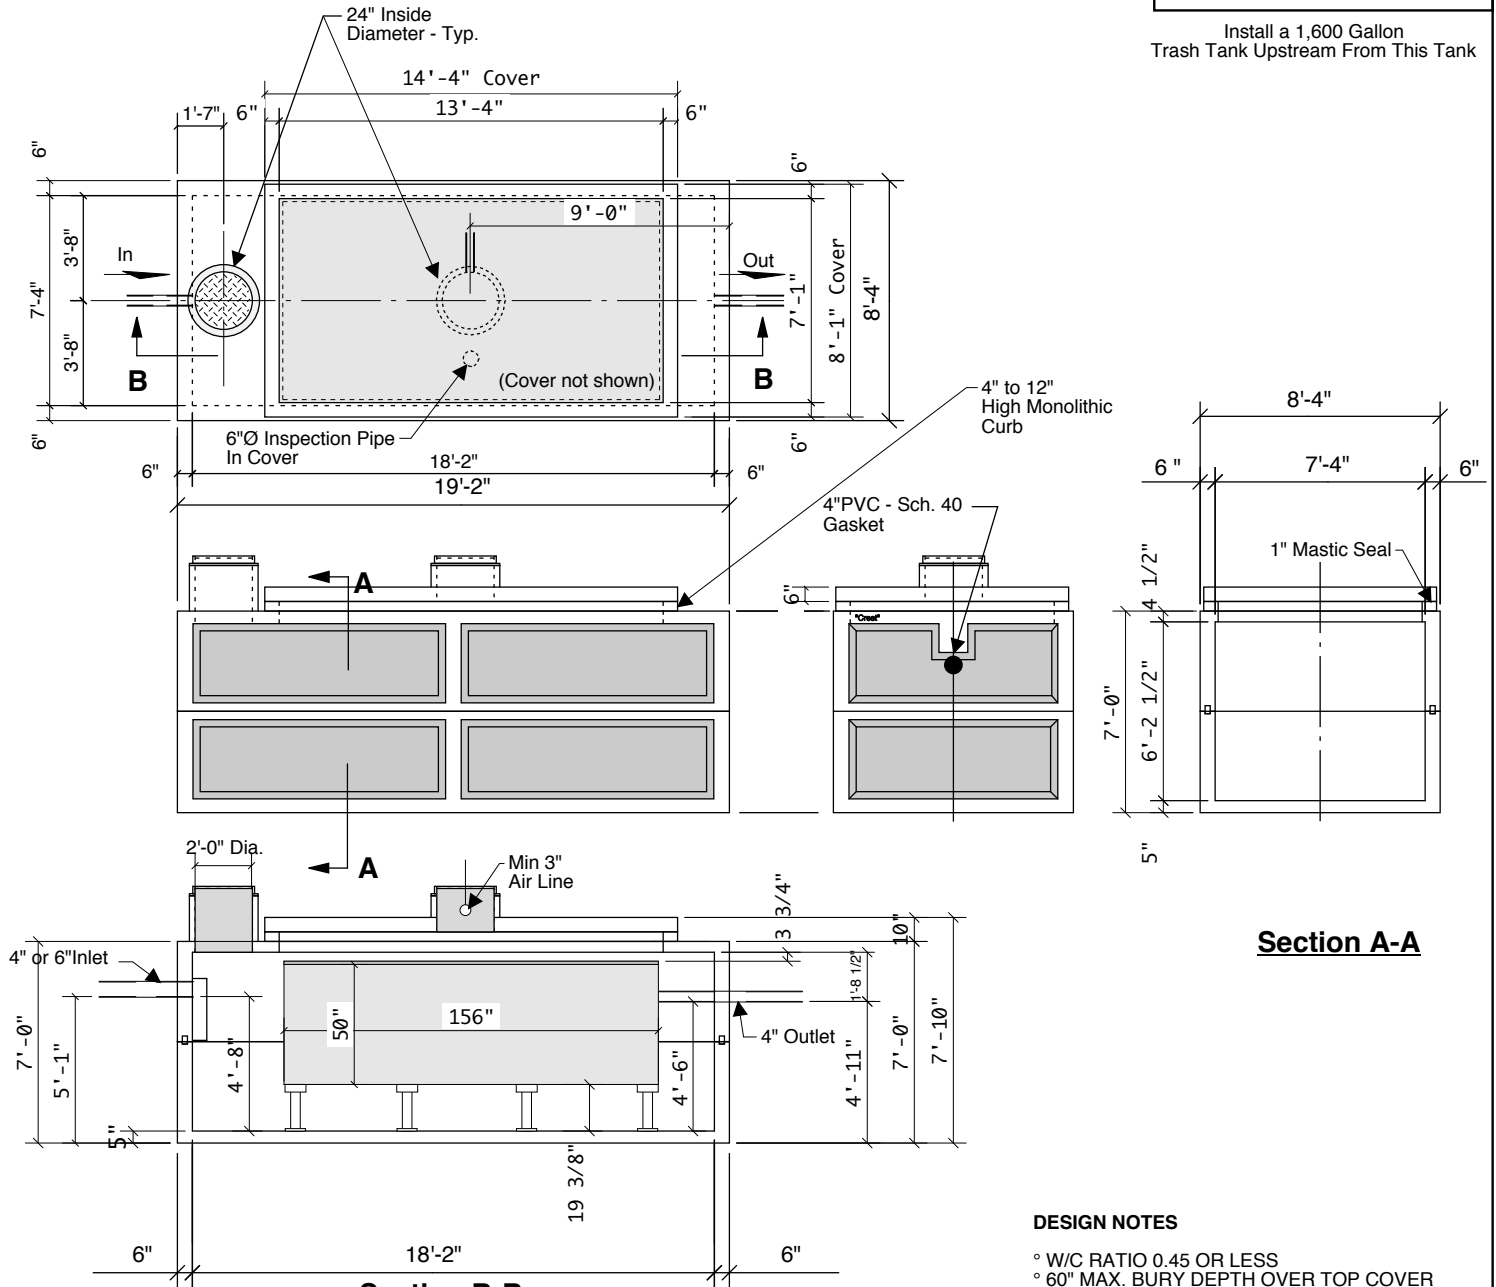

**Section A-A**

**Section B-B**

## One - Model 4.5 FAST Tank

MICROFAST- HIGHSTRENGTH FAST

### DESIGN NOTES

- W/C RATIO 0.45 OR LESS
- 60" MAX. BURY DEPTH OVER TOP COVER
- RANDOM VACUUM OR WATER TESTING BY CREST

### INSTALLATION NOTES:

- PLUMBING CONTRACTOR TO SEAL FAST UNIT TO TANK COVER. PLUMBER OR DEALER TO PROVIDE SEMI-ANNUAL INSPECTIONS OR SERVICE.
- Follow CREST bedding and backfill instructions.

### EFFLUENT EQUALITY (AVERAGE VALUE)

- LESS THAN 10 MG/L B.O.D.
- LESS THAN 10 MG/L S.S.
- LESS THAN 10 MG/L PHOSPHORUS

### ◦ SPECIFICATIONS

- CONCRETE - 5,000 PSI
- REINFORCE 6" OCEW
- MASTIC EZ STICK
- RUBBER BOOTS @ INLET & OUTLET - PRESS SEAL OR A-LOK BRAND
- SEAL AND ATTACH FAST INSERT TO PRECAST TANK PER MFG. INSTRUCTIONS
- INLETS & OUTLETS CAN BE 4" OR 6" DIA.

*Crest Precast, Inc.*

*La Crescent, MN & Barneveld, WI*

800-658-9045

Scale	Drawn By: KGT
Date	Revision
<b>Project: Bio-Microbics F.A.S.T. - MCF 4.5</b>	
<b>Contractor:</b>	Drawing Number <b>MODEL 5000-4.5</b>